



NOTES:


1. THESE FASTENING PATTERNS ARE TO BE USED WHEN THE PROJECT REQUIRES A FACTORY MUTUAL RATED SYSTEM. CONTACT MULE-HIDE TECHNICAL DEPARTMENT FOR APPROPRIATE USE OF THESE PATTERNS.
2. MULE-HIDE INSULATION FASTENERS AND 3" DIAMETER PLATES MUST BE USED FOR INSULATION ATTACHMENT.
3. REFER TO MULE-HIDE WIND UPLIFT RATINGS FOR APPROPRIATE FASTENER DENSITY REQUIRED.
4. FASTENER DENSITY INCREASES BASED ON THE FOLLOWING:
  - 50% FOR PERIMETERS WITH A MINIMUM OF 1 FASTENER EVERY 2 SQUARE FEET NOT TO EXCEED 1 FASTENER EVERY 1 SQUARE FEET
  - CONSTANT DENSITY OF 1 FASTENER EVERY 1 SQUARE FEET FOR CORNERS.

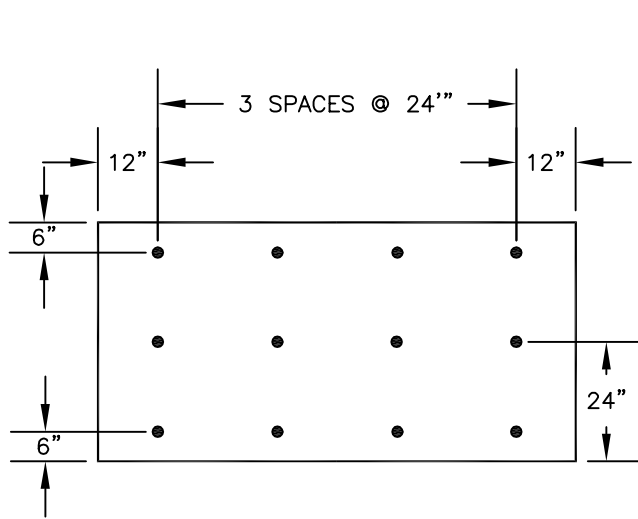

FIELD (12)  
1 FASTENER PER EVERY 2.66 SQ. FT.

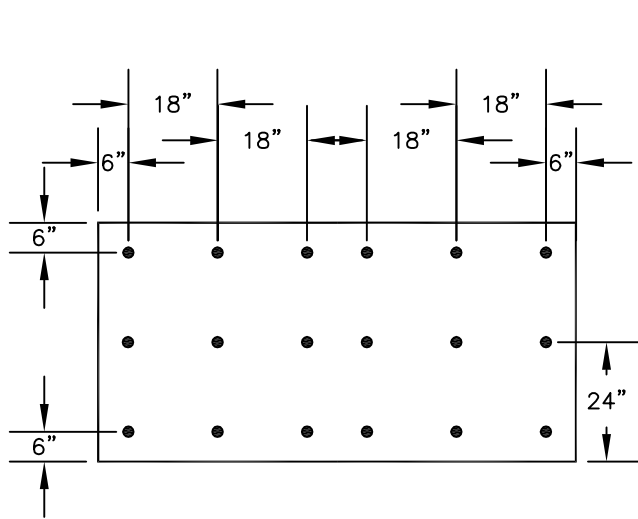

PERIMETER (18)  
1 FASTENER PER EVERY 1.77 SQ. FT.

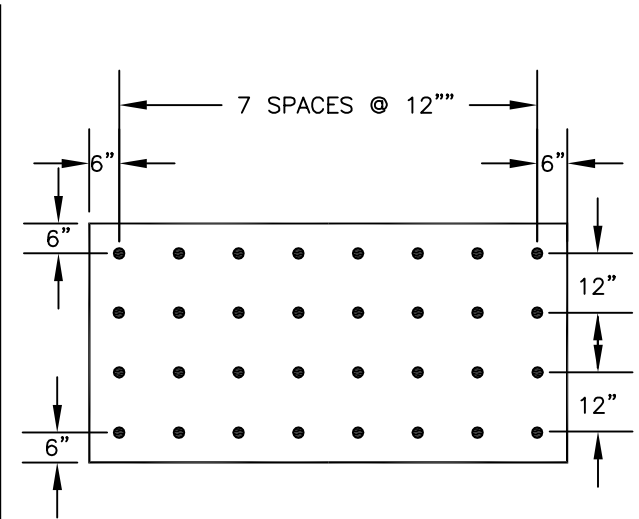

CORNERS (32)  
1 FASTENER PER EVERY 1 SQ. FT.

**MULE-HIDE  
PRODUCTS CO., INC.**

**FM - 12 FIELD FASTENERS  
PER 4' X 8' BOARD PATTERN LAYOUT  
SYSTEMS:  
FULLY ADHERED**

**DETAIL NO.:**  
**MHT-FM-725**  
REVISION DATE: 06/2015