

6" RUSS INSTALLED ON ONE SIDE OF VALLEY. IF A SEAM IS WITHIN 48" OF THE VALLEY, PLACE RUSS ON SIDE OF VALLEY OPPOSITE OF SEAM – MUST USE TAPE PRIMER WITH RUSS – NOTE 3


MH 2.4" SEAM PLATES AND HDP OR EHD FASTENERS 12" O.C. MAX – NOTE 1

TPO REINFORCED MEMBRANE

NOTE 2

MINIMUM 2" HOT AIR WELD

MH 2.4" SEAM PLATES AND HDP OR EHD FASTENERS 12" O.C. MAX – NOTE 1

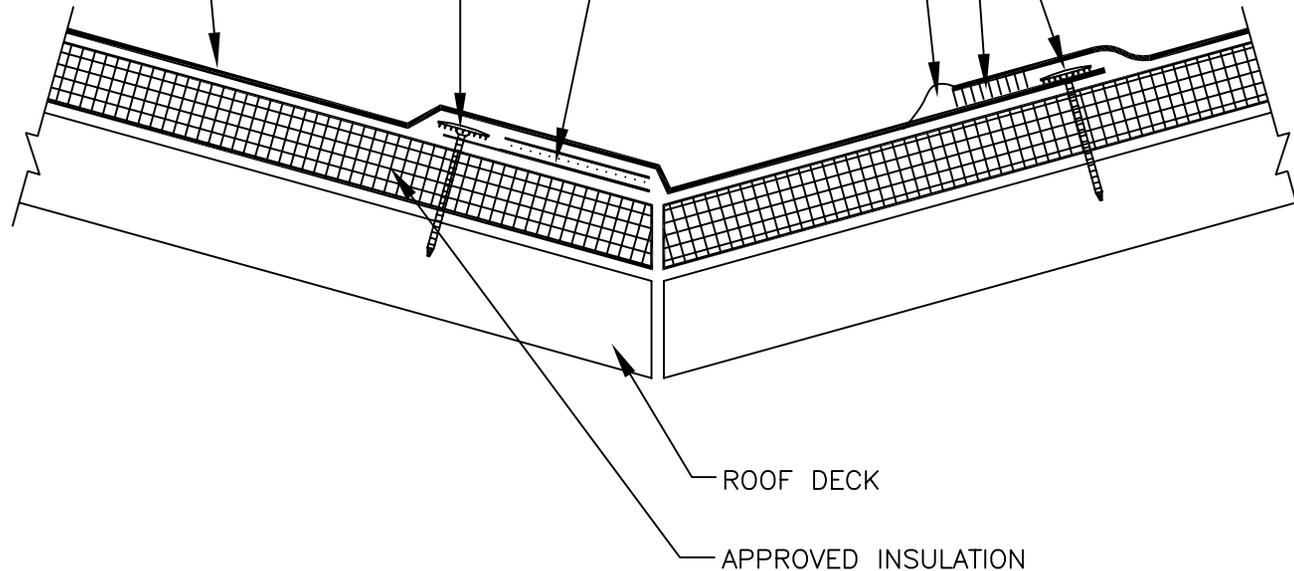

NOTES:

1. MEMBRANE FASTENER SPACING NOT TO EXCEED 12" O.C.
2. APPROXIMATELY 1/8" DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF TPO REINFORCED MEMBRANE.
3. RUSS PRODUCTS CANNOT BE USED WITH FLEECEBACK OR SELF ADHERING MEMBRANES.

NOTE:

THIS DETAIL IS ACCEPTABLE FOR USE IN A 20-YEAR WARRANTED SYSTEM

**MULE-HIDE
PRODUCTS CO., INC.**

**VALLEY FLASHING
6" RUSS
SYSTEMS:**

MECHANICALLY ATTACHED

DETAIL NO.:

MHT-MA-601B

REVISION DATE: 10/2013